



SGS Canada Inc.

P.O. Box 4300 - 185 Concession St.
Lakefield - Ontario - K0L 2H0
Phone: 705-652-2000 FAX: 705-652-6365

Works #: 500039092

Project : PO#017470

21-September-2020

OCWA-Espanola (Monetville Public School - O.Reg243)

Attn : Keith Stringer

Date Rec. : 17 September 2020

LR Report: CA16775-SEP20

148 Fleming Street, Suite 5
Espanola, ON
P5E 1R8, Canada

Copy: #1

Phone: 705-869-5578
Fax:

CERTIFICATE OF ANALYSIS


Final Report

Sample ID	Sample Date & Time	Sampled By	Temperature Upon Receipt °C	Lead ug/L
1: Analysis Start Date			---	21-Sep-20
2: Analysis Start Time			---	08:54
3: Analysis Completed Date			---	21-Sep-20
4: Analysis Completed Time			---	11:09
5: MAC			---	10
6: MDL			---	0.01
7: TAP Standing-Staff Kitchen	16-Sep-20 06:40	Luc Pharand	16.0	2.00
8: TAP Flushed-Staff Kitchen	16-Sep-20 07:15	Luc Pharand	16.0	0.50

MAC - Maximum Acceptable Concentration
MDL - SGS Method Detection Limit

Method Descriptions

Units	Description	SGS Method Code
ug/L	Lead by ICP-MS Drinking Water	ME-CA-[ENV]SPE-LAK-AN-006

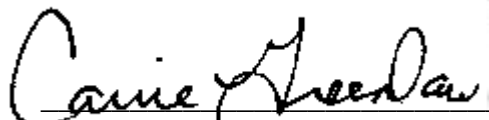

Carrie Greenlaw
Project Specialist,
Environment, Health & Safety